


LIMITED AREA SPRINKLER SYSTEM FROM EXISTING DOMESTIC WITH NO BACKFLOW DEVICE REQUIRED

NOTE:


ADDITION OF BACKFLOW DEVICE ONTO EXISTING FIRE SUPPRESSION SYSTEMS WILL AFFECT ORIGINAL FLOW CALCULATIONS.

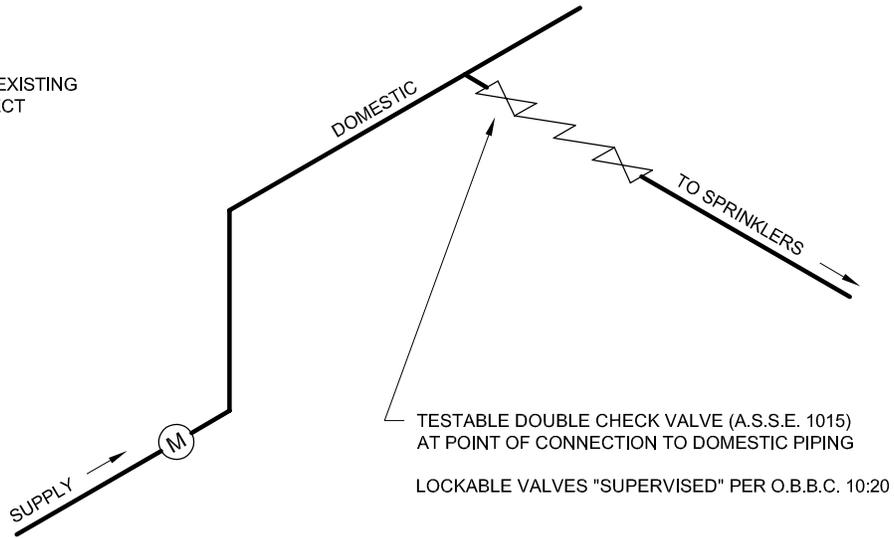

LIMITED AREA SPRINKLER SYSTEM

NOTE:

ADDITION OF BACKFLOW DEVICE ONTO EXISTING FIRE SUPPRESSION SYSTEMS WILL AFFECT ORIGINAL FLOW CALCULATIONS.

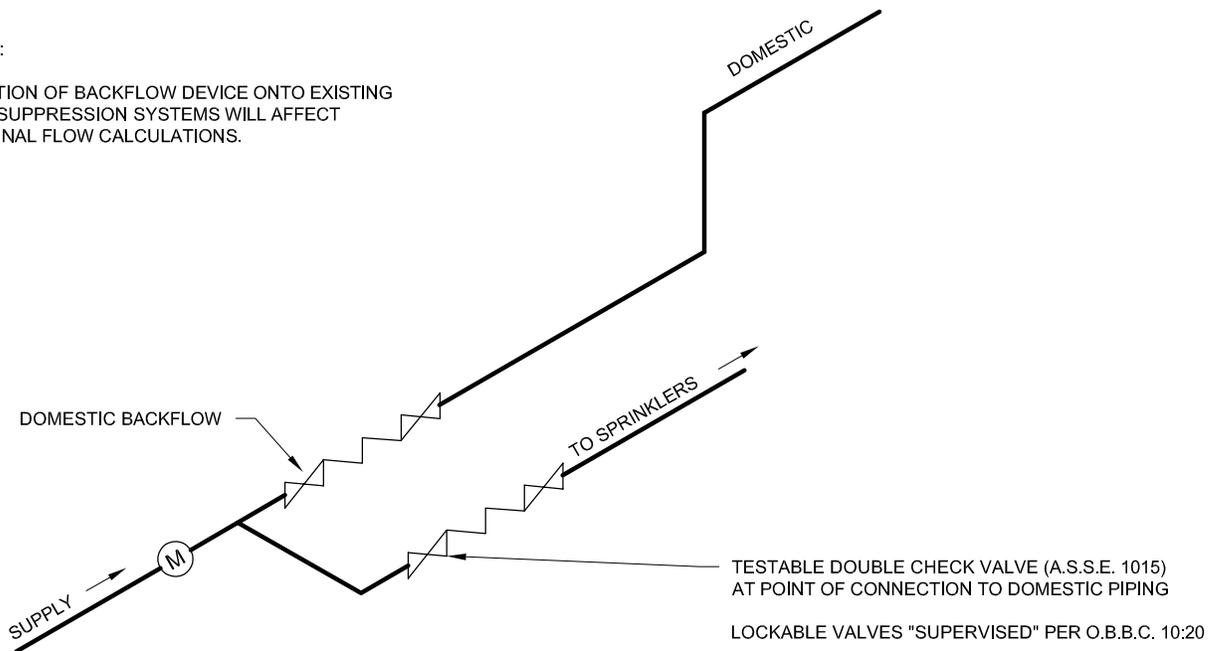

DRAWING NOT TO SCALE

LIMITED AREA SPRINKLER SYSTEMS

CITY OF BOWLING GREEN
PUBLIC WORKS DEPARTMENT
ENGINEERING DIVISION

STD DWG 15
SH 5 OF 5
REV 03/2019