


STANDARD HYDRANT ASSEMBLY - TYPE "A"
PARALLEL TO WATER LINE

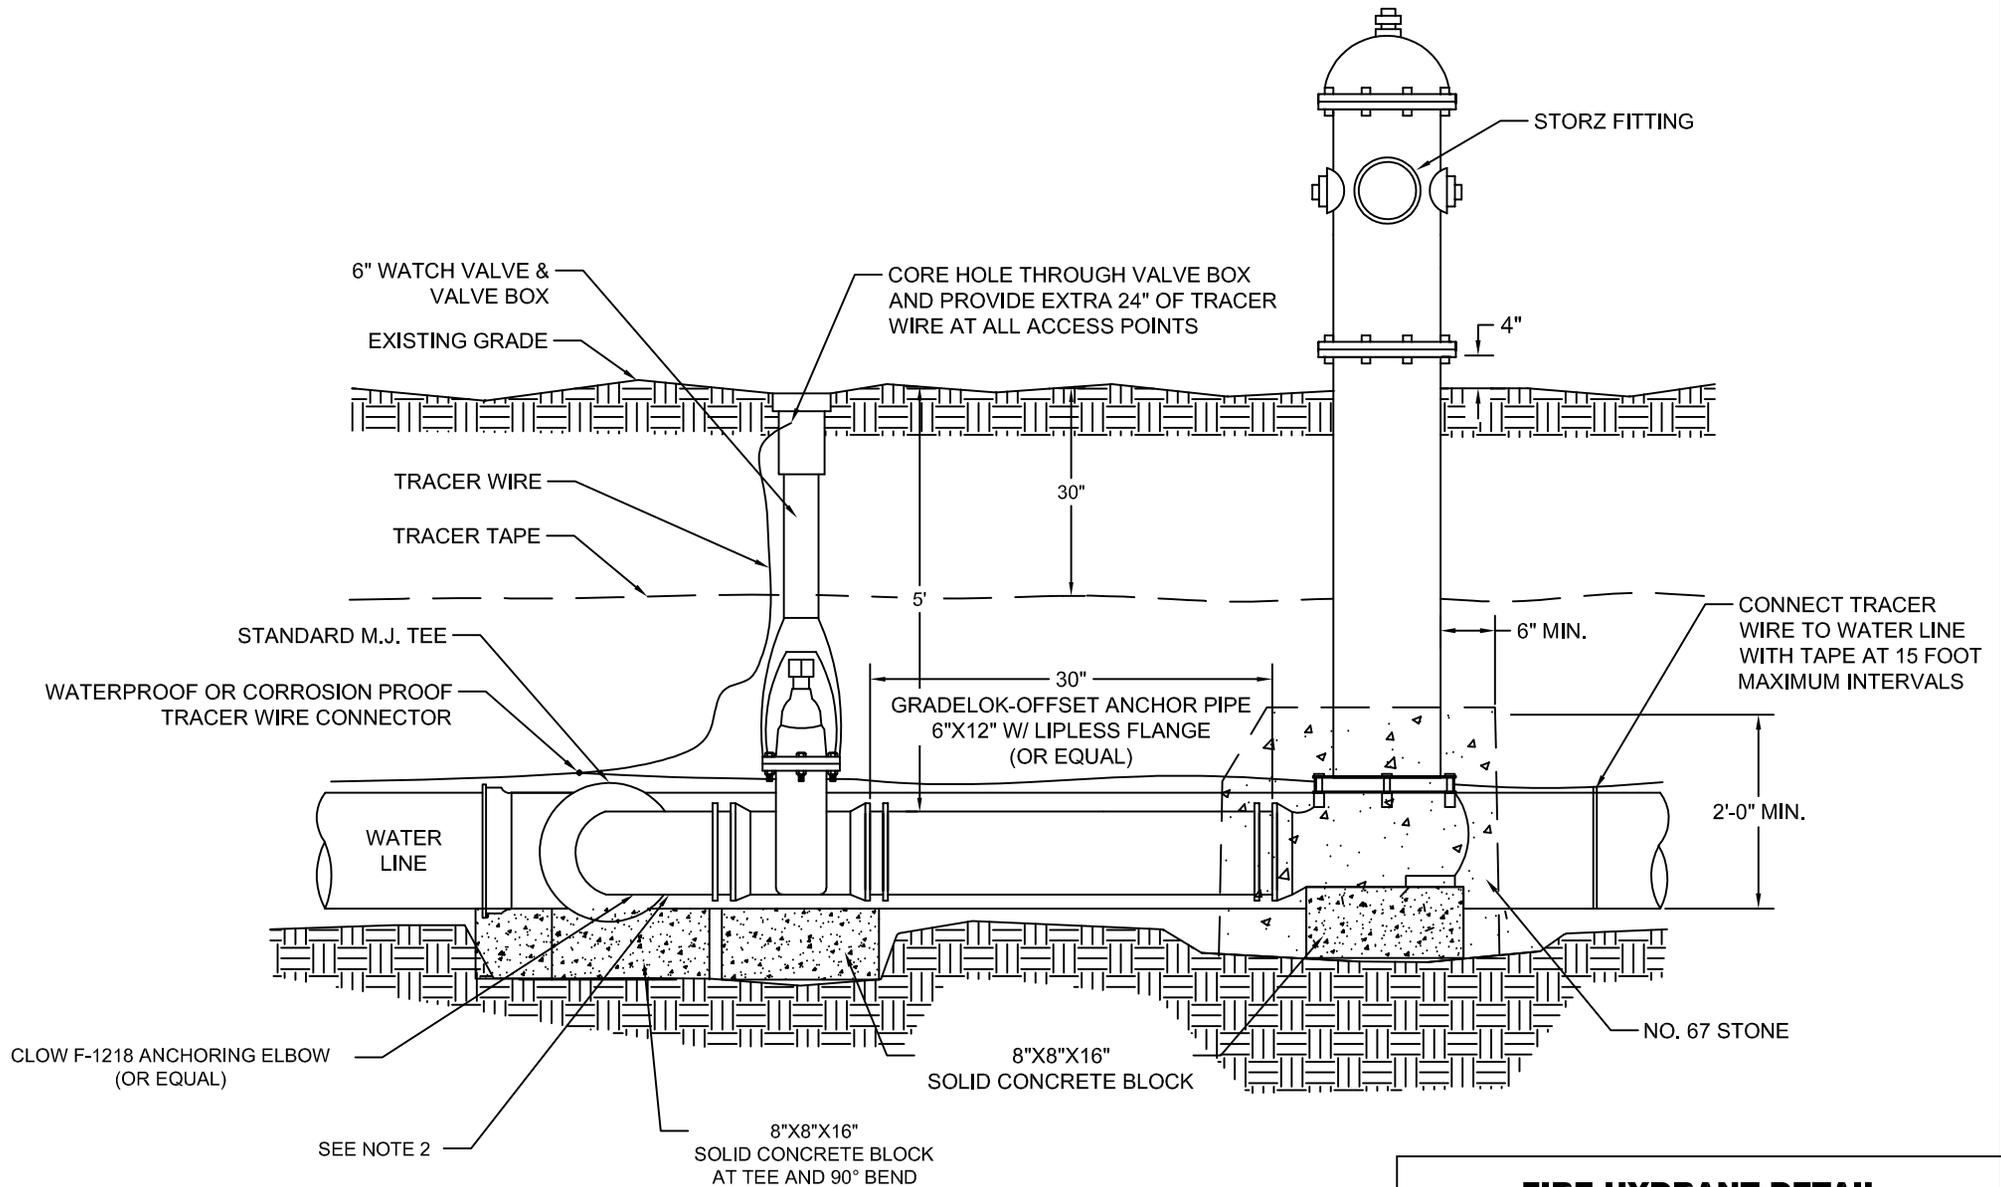

NOTES:

1. HYDRANT DRAINS SHALL NOT BE PLUGGED. A 10 CUBIC FOOT GRAVEL POCKET (NO. 67 STONE) OR DRY WELL SHALL BE PROVIDED UNLESS THE NATURAL SOILS WILL PROVIDE ADEQUATE DRAINAGE IN ACCORDANCE WITH TEN STATES STANDARDS 8.4.4.
2. PROVIDE PIPING AND FITTINGS NECESSARY FOR VERTICAL OR HORIZONTAL OFFSETS BETWEEN THE TEE AND VALVE.
3. HYDRANT EXTENSIONS SHALL NOT BE PERMITTED.

FIRE HYDRANT DETAIL
TYPE A

CITY OF BOWLING GREEN
 PUBLIC WORKS DEPARTMENT
 ENGINEERING DIVISION

STD DWG 7
SH 1 OF 2
REV 03/2019