


**STANDARD HYDRANT ASSEMBLY - TYPE "B"
PERPENDICULAR TO WATER LINE**

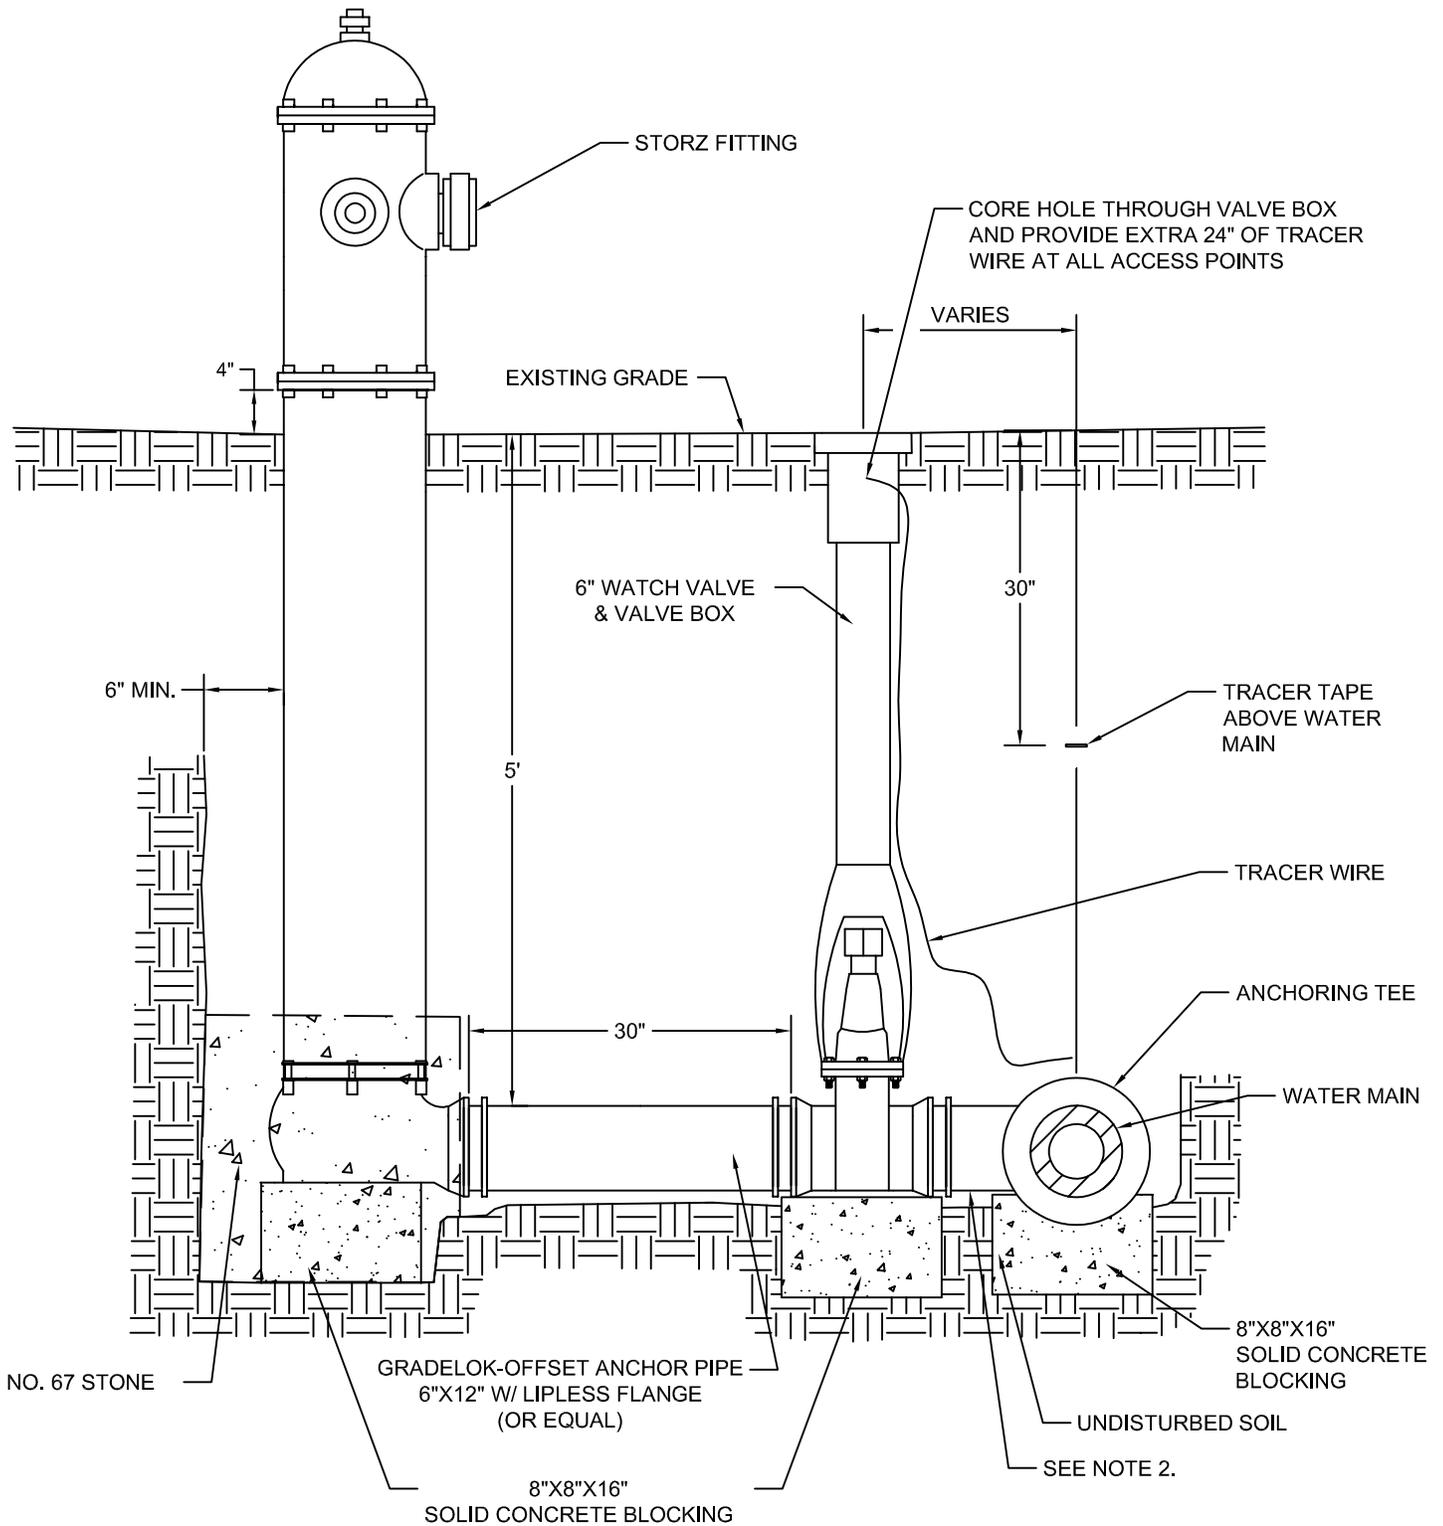

NOTES:

1. HYDRANT DRAINS SHALL NOT BE PLUGGED. A 10 CUBIC FOOT GRAVEL POCKET (NO. 67 STONE) OR DRY WELL SHALL BE PROVIDED UNLESS THE NATURAL SOILS WILL PROVIDE ADEQUATE DRAINAGE IN ACCORDANCE WITH TEN STATE STANDARDS 8.4.4.
2. PROVIDE PIPING AND FITTINGS NECESSARY FOR VERTICAL AND HORIZONTAL OFFSETS BETWEEN THE TEE AND VALVE.
3. HYDRANT EXTENSIONS SHALL NOT BE PERMITTED.

**FIRE HYDRANT DETAIL
TYPE B**

CITY OF BOWLING GREEN
PUBLIC WORKS DEPARTMENT
ENGINEERING DIVISION

STD DWG 7
SH 2 OF 2
REV 03/2019